



BOROUGH OF LAVALLETTE

1306 GRAND CENTRAL AVENUE
LAVALLETTE, NJ 08735
(732) 793-7477
Fax (732) 830-8248
www.lavallette.org

Water Service Line Material Survey

Dear Resident:

In July 2021, P.L.2021, Ch.183 (Law) was enacted, requiring all community water systems to replace lead and galvanized service lines in their service area within 10 years. Under the law, the Borough of Lavallette is required to inventory public and private water services to identify all service line materials.

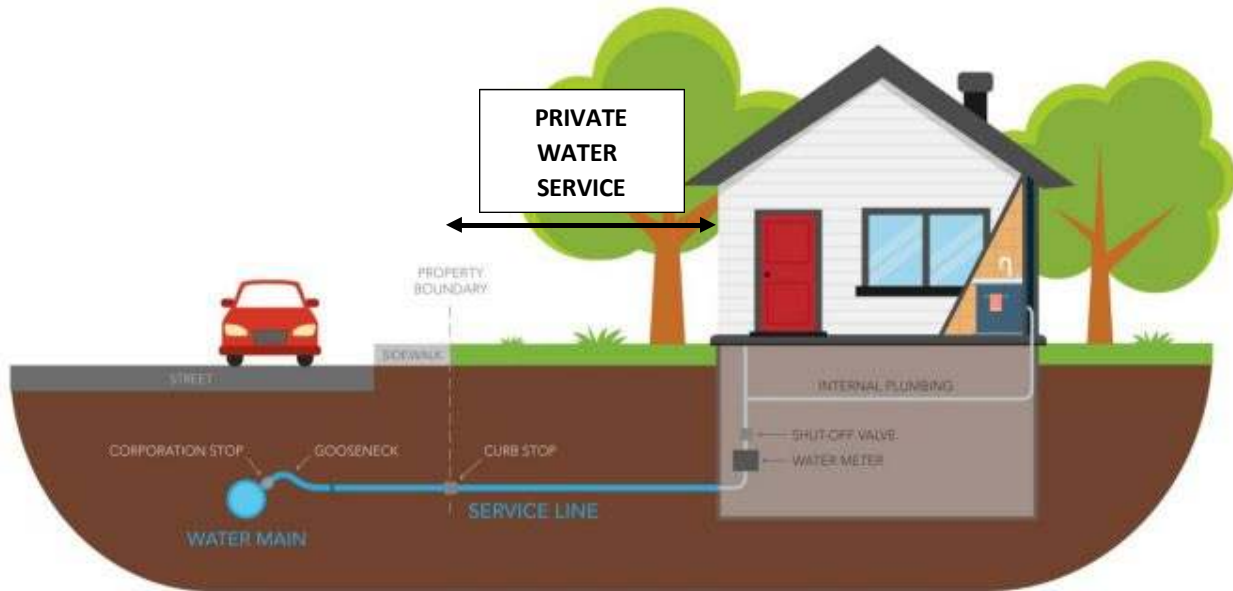


Image from: Lead Service Line Replacement Collaborative (2021)

In an effort to report all private water service line materials to the State of New Jersey, the Borough of Lavallette is requesting you, the Homeowner, to inspect your current water service and determine the material that has been installed for your property. Enclosed with this letter you will find pictures of the following water service materials:

1. Copper Water Service
2. Polyethylene (Plastic) Water Service
3. Galvanized Water Service

The **Borough of Lavallette** is requesting that you complete the attached survey to help determine the material type of the private water service line at this address. Survey can be returned via regular mail, via municipal drop-box, or via e-mail to publicworks@lavallette.org. You can also complete the form directly on our website that automatically submits the information.

For reporting purposes or to ask any questions regarding this matter, you can contact Charles Farrah via email at publicworks@lavallette.org or via phone at 732-793-7766.

Borough of Lavallette - Water Service Material Survey

Name: _____

Address: _____

Please identify your Private Water Service Material Type

Return to Township via regular mail, via Township drop-box, or via
e-mail to publicworks@lavallette.org

Copper Water Service



Polyethylene (Plastic) Water Service



Galvanized Water Service



Date of install (If Known) _____

Size (If Known) _____